



Report No: MDD:WAI21S-02048

Issue No: 1

Maximum Dry Density Report

Client:
 Manukau Quarries LP
 P O Box 202230
 Takanini

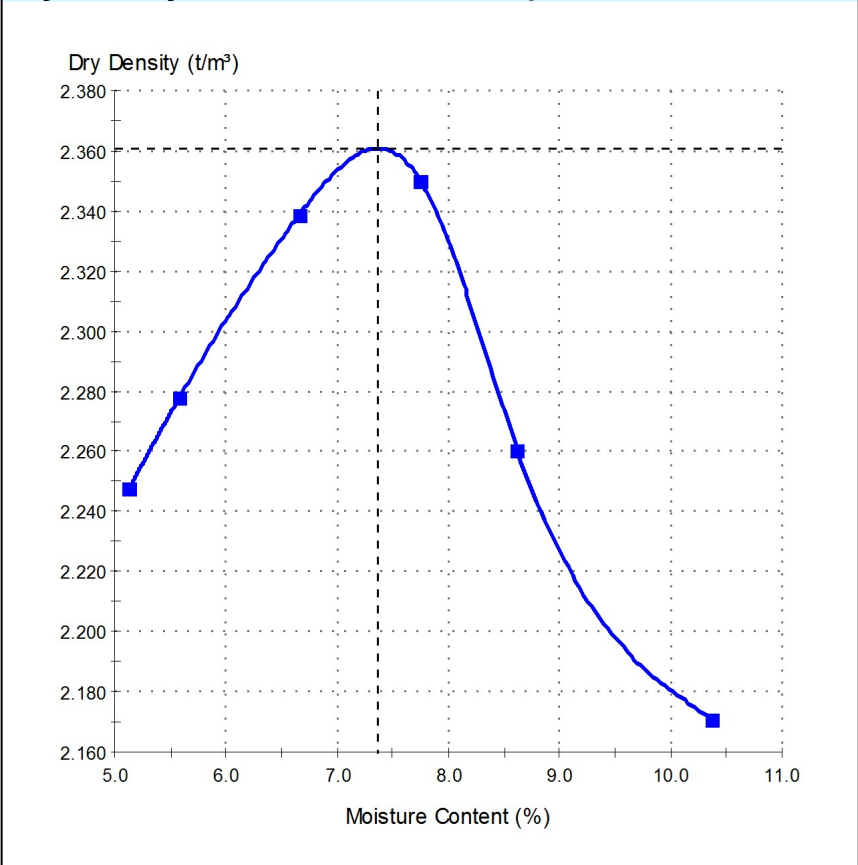
 Auckland 2246
 NZ
Project: Laboratory Testing

ACCREDITED

 TESTING LABORATORY
 The tests reported herein (unless otherwise indicated) have been performed in accordance with the laboratory's scope of accreditation. Samples are tested as received, in natural condition, unless stated otherwise in the comments. This report may only be reproduced in full.

 Approved Signatory: Ross Lambert
 (IANZ/Bituminous Supervisor)
 IANZ Accreditation No:561
 Date of Issue: 17/06/2021
 The results in this report relate only to the items / samples that were tested

Sample Details

Sample ID: WAI21S-02048	Client Sample ID: Manarc 65 MR8
Material:	Sample Source:
Site/Sampled From:	Date Sampled: 04/06/2021
Specification: Clevedon - Manarc 65 MR8	Sampled By: Unknown
Sampling Method: Not Advised - Not Accredited	Date Tested: 17/06/2021
Technician: Ivan Jordanov	Sampling Endorsed?: No

Dry Density - Moisture Relationship



Test Results

NZS 4402:1986 Test 4.1.3 - 1986
Maximum Dry Density (t/m³): 2.36
Optimum Moisture (%): 7.5
Sample History:
Tested By: Rijo Koshy
Date Tested: 16/06/2021

Comments